


# System No. C-AJ-0067

November 29, 1999

**F Rating — 3 Hr.**

**T Rating — 2 Hr.**

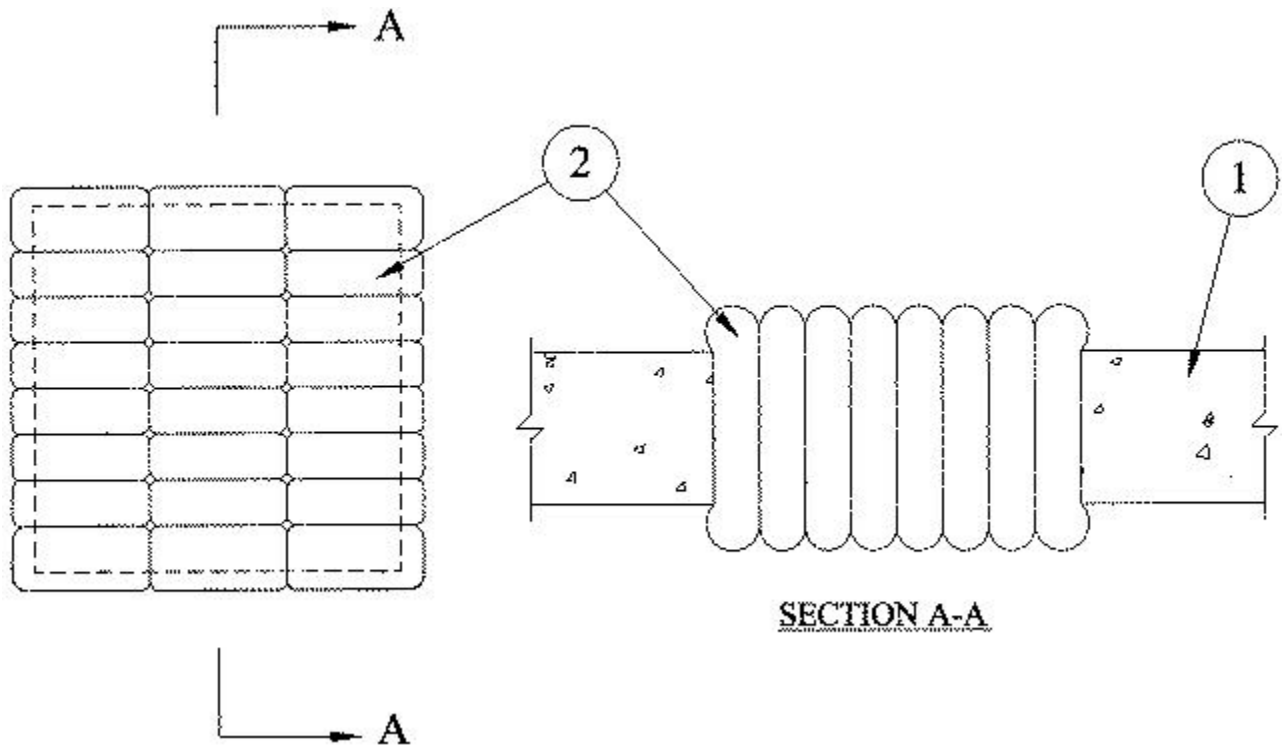

**1. Floor or Wall Assembly** — Min 5 in. thick reinforced normal weight (140-150 pcf) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks\***. Max area of opening is 144 sq in. with max dimensions of 12 in.

See **Concrete Blocks (CAZT)** category in the Fire Resistance Directory for names of manufacturers.

**2. Fill, Void or Cavity Materials\*— Pillows** — Nom 8 in. long by 4 in. wide by 2 in. thick pillow-like material. Pillows shall be tightly packed into opening. Pillows installed with 8 in. dimension projecting through floor or wall and centered within the opening.

**A/D FIRE PROTECTION SYSTEMS INC** — A/D FireBarrier Pillows

\*Bearing the UL Classification Mark